



## November 2016 Water Quality Summary Report

### Barangaroo South – Remediation Works

**Licence Number:** 13336

**Licensee:** Barangaroo Delivery Authority

**Licensee Address:** Level 21, 201 Kent Street, Sydney

**Sampling period:** 1 to 30 November 2016

**Date provided to Licensee:** 20 December 2016

**Date published:** 20 December 2016

# November 2016 Water Quality Summary Report

## Barangaroo South – Remediation Works


This report has been compiled to summarise results of water quality monitoring at Barangaroo South in November 2016 in accordance with [EPL number 13336](#). This data is for samples taken from 1 to 30 November 2016. The data was provided to the Barangaroo Delivery Authority (the Licencee) on 20 December 2016.

Lend Lease conducts water quality monitoring at Barangaroo South to measure water quality and assist the construction team implement appropriate environmental controls on site.

Water quality monitoring is carried out in accordance with all relevant authority and statutory requirements. Ambient monitoring in Darling Harbour measures conductivity, pH, temperature and turbidity.

## Water quality monitoring locations

Water quality monitoring locations are located as shown below:

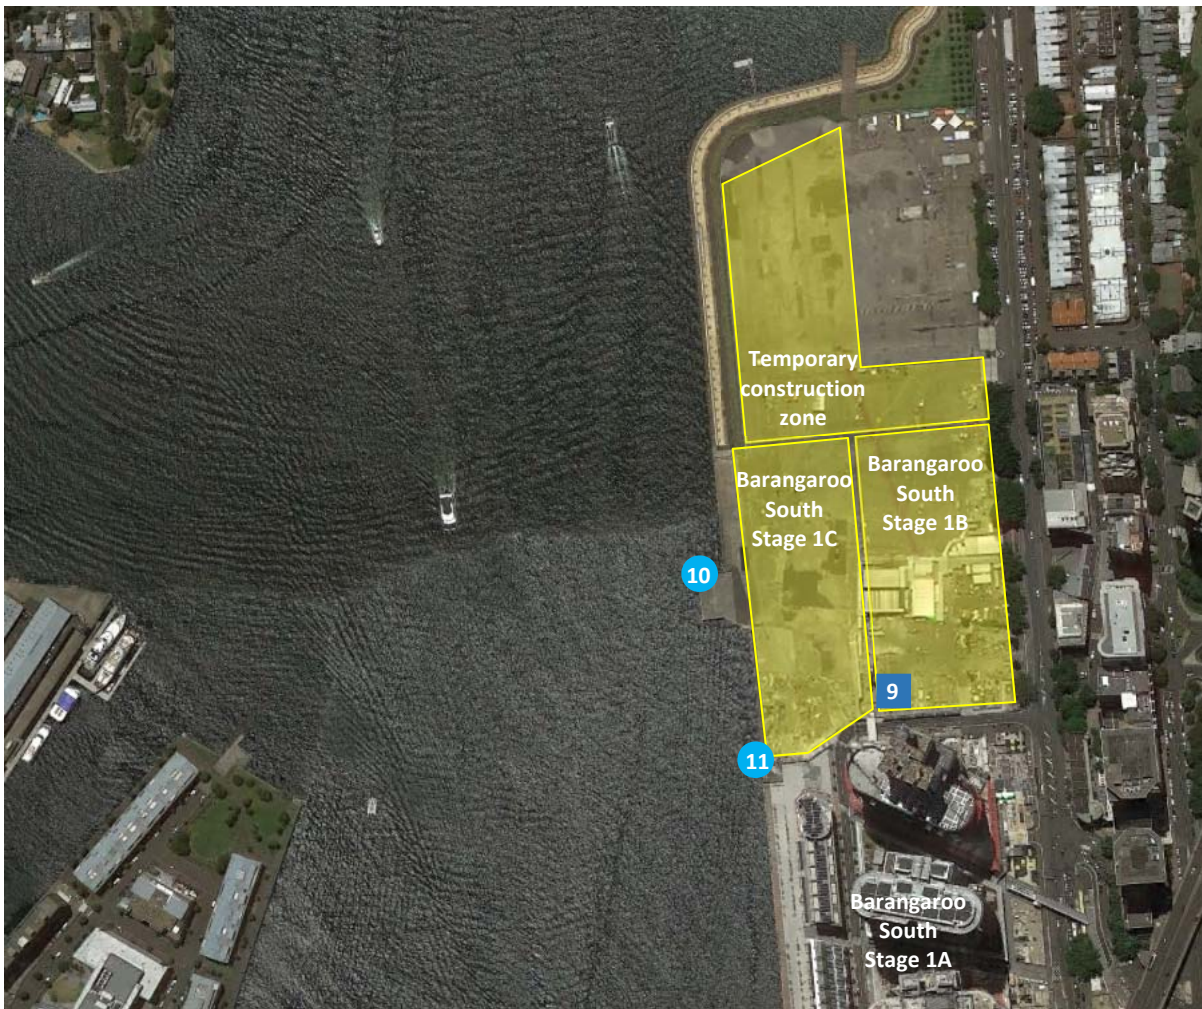

*Approximate location of water quality monitoring equipment*

### Legend

- Ambient Water Quality Monitoring Location
- 9 WTP Water Discharge Point
- X EPL point number

EPL point 10 is the Nearfield 1 (NF1) location, and EPL point 11 is the Nearfield 2 (NF2) location. EPL point 9 is the discharge point for the Perimeter Retention Wall (PRW) water treatment plant (WTP).

## Monitoring results

### WTP Discharge

There was no discharge from the Water Treatment Plant to EPL Point 9 during the month. All captured stormwater was treated and reused on site.

There were no exceedances of turbidity criteria for ambient water quality monitoring in Darling Harbour during the month.

### Turbidity

Monitoring Parameter	EPL Point 10 (NTU)	EPL Point 11 (NTU)
Minimum	1.7	0.0
Maximum	5.0	5.0
Mean	2.5	0.1
Limit	63	63

### Conductivity

Monitoring Parameter	EPL Point 10 (mS/cm)	EPL Point 11 (mS/cm)
Minimum	50.0	51.2
Maximum	54.5	55.5
Mean	54.2	54.0
Limit	No licence limit, monitoring requirement only	

### pH

Monitoring Parameter	EPL Point 10	EPL Point 11
Minimum	7.8	7.9
Maximum	8.3	8.2
Mean	7.9	8.0
Limit	No licence limit, monitoring requirement only	

### Temperature

Monitoring Parameter	EPL Point 10 (°C)	EPL Point 11 (°C)
Minimum	19.4	19.4
Maximum	23.1	23.1
Mean	21.5	21.4
Limit	No licence limit, monitoring requirement only	

### Frequency

Monitoring Parameter	EPL Point 10 (NF1)	EPL Point 11 (NF2)
Monitoring frequency required by licence	Every 15 minutes	
NTU Samples Collected & Analysed	99.8%	99.7%
pH Samples Collected & Analysed	99.8%	99.7%
Conductivity Samples Collected & Analysed	86.6%	99.5%
Temperature Samples Collected & Analysed	99.9%	99.7%